



PLAN
NTS

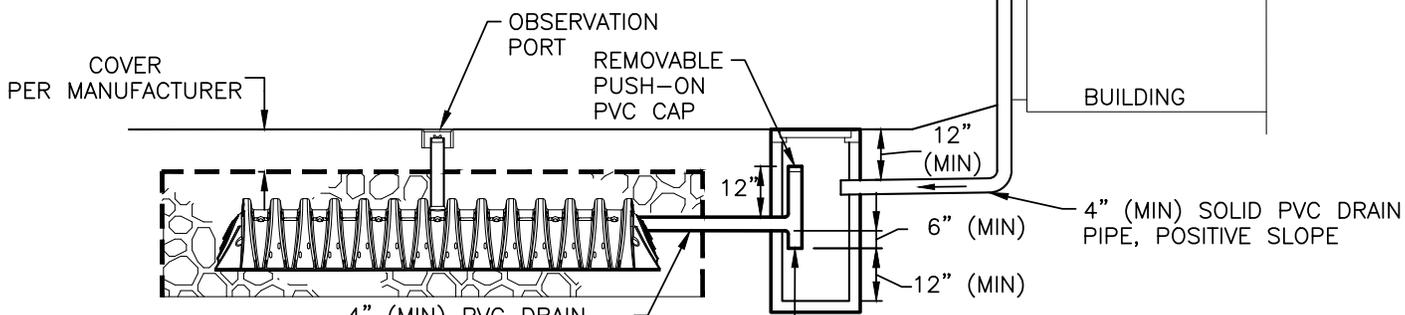

PROFILE
NTS

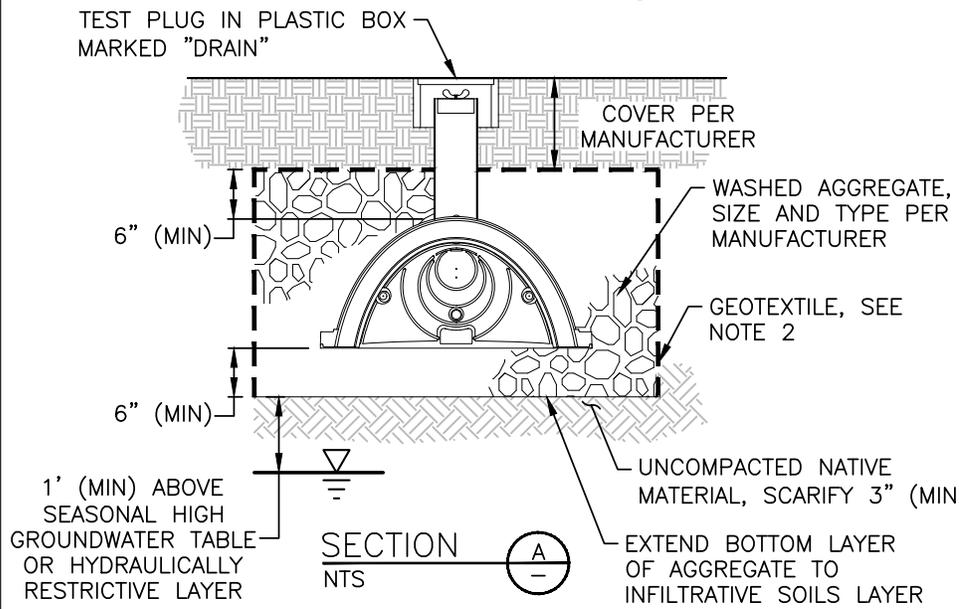


SECTION
NTS

GENERAL NOTES:

1. REFER TO THE 2017 CITY OF EDMONDS STORMWATER ADDENDUM FOR SETBACK (CHECKLIST 13) AND INFEASIBILITY REQUIREMENTS.
2. UNLESS OTHERWISE NOTED, ALL PVC PIPE SHALL BE SCH. 40 CONFORMING TO ASTM D1785 REQS.
3. MIN. COVER DEPTHS ASSUME NO VEHICULAR LOADING. DESIGNER TO SPECIFY COVER DEPTHS IF VEHICULAR TRAFFIC ANTICIPATED.

NOTES:

1. THE FOLLOWING PRODUCTS ARE KNOWN TO MEET THESE GRAVELLESS CHAMBER CRITERIA:
STORMTECH® SC-310 BY STORMTECH LLC. QUICK 4 HIGH CAPACITY CHAMBER BY INFILTRATOR SYSTEMS INC.
2. PLACE GEOTEXTILE FABRIC ALONG WALLS AND TOP OF WASHED ROCK. GEOTEXTILE SHALL CONFORM TO WSDOT SPEC. 9-33.2(1), GEOTEXTILE FOR SEPARATION, NON-WOVEN TYPE.



CITY OF EDMONDS
PUBLIC WORKS
DEPARTMENT

**TYPICAL ROOF DOWNSPOUT
GRAVELLESS CHAMBER**

APPROVED BY: R. ENGLISH

REVISION DATE
DECEMBER 2017

STANDARD
DETAIL
SD-637