


PLAN

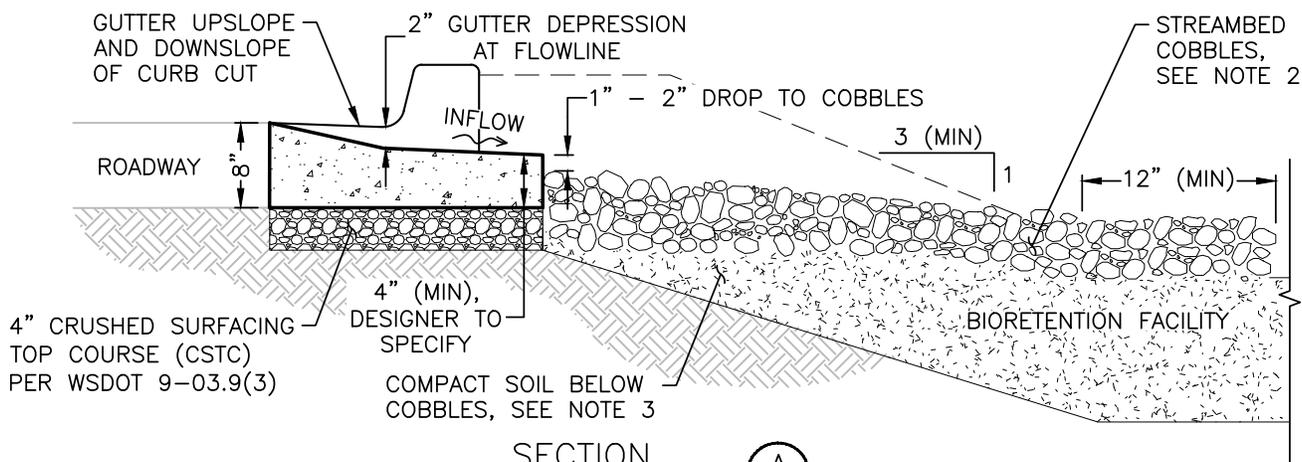

SECTION  
NTS

**GENERAL NOTES:**

1. ALL WORK AND MATERIALS SHALL CONFORM TO WSDOT SPEC. 8-04, CURBS, GUTTERS, AND SPILLWAYS REQUIREMENTS FOR CEMENT CONCRETE CURB AND GUTTER, EXCEPT FINISH SHALL BE LIGHT BROOM.
2. BOND NEW CURB AND GUTTER TO EXISTING CURB AND GUTTER WITH EPOXY AND DOWEL CONNECTION, IF RETROFITTING INTO EXISTING CURBLINE.

**NOTES:**

1. INLET CURB CUT WIDTH SHALL BE 18" (MIN) WHEN BIORETENTION CONTRIBUTING AREA IS A "HIGH USE" AREA, AS DEFINED IN THE 2017 CITY OF EDMONDS STORMWATER ADDENDUM AND 24" ON GUTTER SLOPES  $\geq$  5%.
2. STREAMBED COBBLES SHALL BE 6" COBBLES PER WSDOT SPEC. 9-03.11(2). COBBLE PAD TO BE 8" THICK. WIDTH TO BE 6" WIDER THAN SPLASH APRON ON BOTH SIDES (3'-6" MIN), THEN TAPER TO 12" WIDE AT SLOPE BOTTOM.
3. COMPACT BIORETENTION SOIL MEDIA USING NON-MECHANICAL COMPACTION METHODS (E.G., BOOT PACKING, HAND TAMPING) TO 88 PERCENT (+/- 2%) OF THE MAXIMUM DRY DENSITY PER MODIFIED PROCTOR TEST (ASTM D1557).



**CITY OF EDMONDS**  
PUBLIC WORKS  
DEPARTMENT

**BIORETENTION  
CURB CUT**

APPROVED BY: R. ENGLISH

REVISION DATE  
DECEMBER 2017

STANDARD  
DETAIL  
TR-602