



CONCRETE BAND WITHIN PAVED AREA

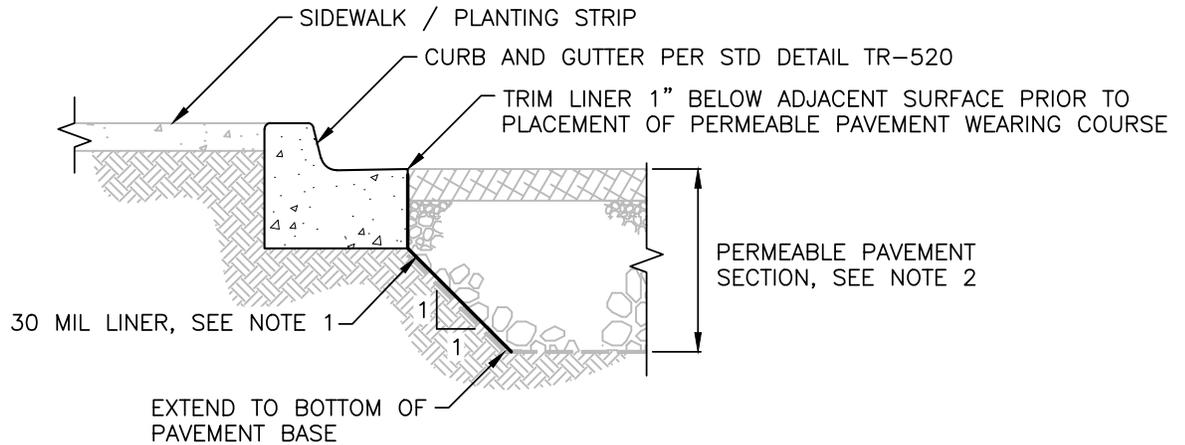

IMPERMEABLE LINER AT STANDARD CURB AND GUTTER

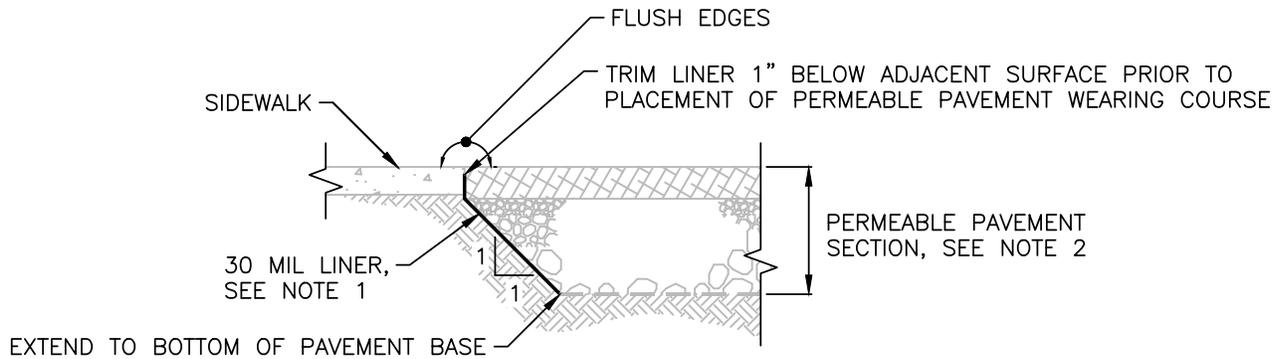

IMPERMEABLE LINER AT EXISTING SIDEWALK

NOTES:

1. IMPERMEABLE LINER SHALL BE HDPE CONFORMING TO GEOSYNTHETIC RESEARCH INSTITUTE (GRI) GM13 OR LLDPE CONFORMING TO GRI GM 17.
2. SEE STD DETAIL SD-621 THROUGH SD-624 FOR PERMEABLE PAVEMENT SECTION.
3. CONCRETE SHALL BE CLASS 3-3000 PSI. CONCRETE REINFORCEMENT AND EXPANSION JOINT PLACEMENT TO BE SPECIFIED BY ENGINEER.



CITY OF EDMONDS
PUBLIC WORKS
DEPARTMENT

**EDGE TREATMENTS
AT PAVEMENT INTERFACE**

APPROVED BY: R. ENGLISH

REVISION DATE
DECEMBER 2017

STANDARD
DETAIL
TR-606