


PROVIDE SWALE, GRADE TO DRAIN TO APPROVED SYSTEM. 1'-0" COMPACTED SOIL OVER GEOTEXTILE

GRAVITY BLOCK WALLS SHALL NOT BE CONSTRUCTED IN THE CITY R.O.W.


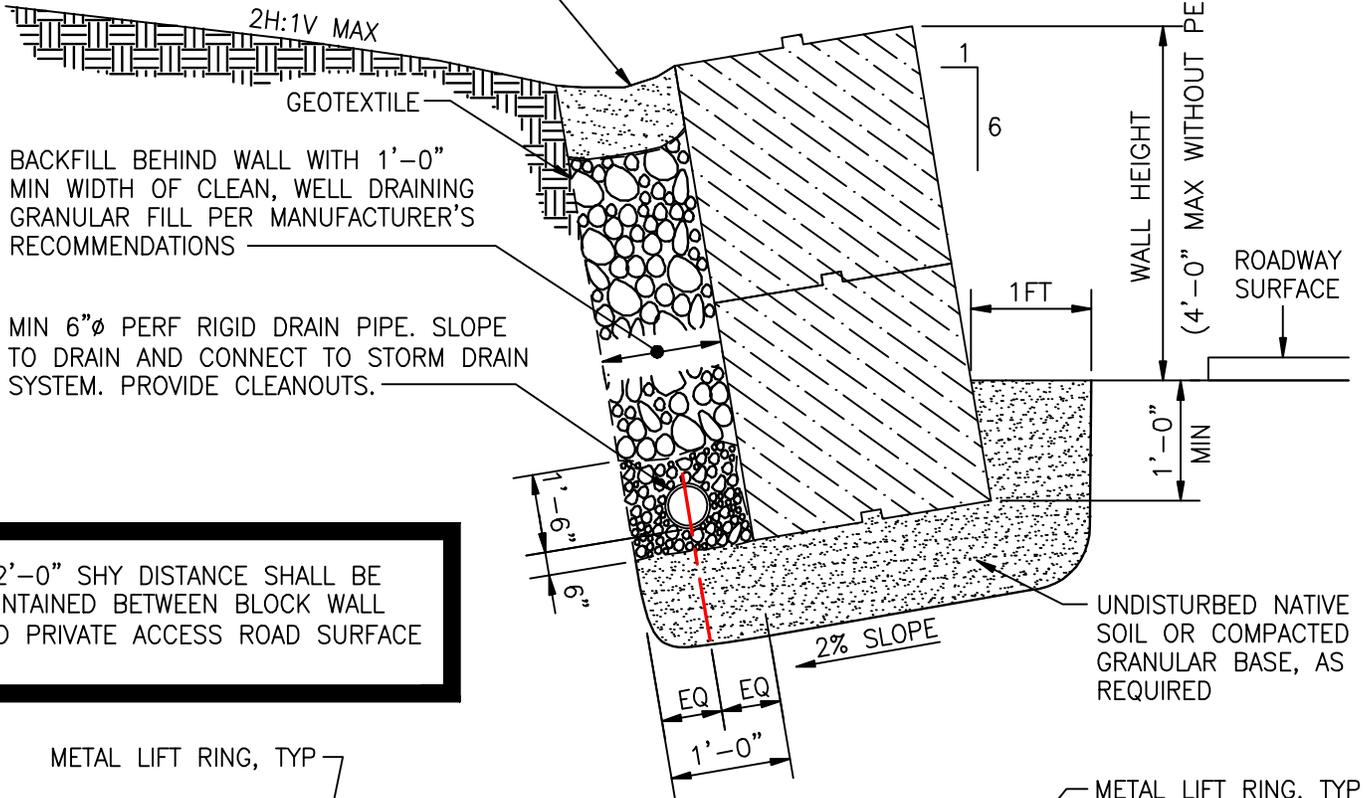


BACKFILL BEHIND WALL WITH 1'-0" MIN WIDTH OF CLEAN, WELL DRAINING GRANULAR FILL PER MANUFACTURER'S RECOMMENDATIONS

MIN 6"Ø PERF RIGID DRAIN PIPE. SLOPE TO DRAIN AND CONNECT TO STORM DRAIN SYSTEM. PROVIDE CLEANOUTS.


A 2'-0" SHY DISTANCE SHALL BE MAINTAINED BETWEEN BLOCK WALL AND PRIVATE ACCESS ROAD SURFACE

UNDISTURBED NATIVE SOIL OR COMPACTED GRANULAR BASE, AS REQUIRED

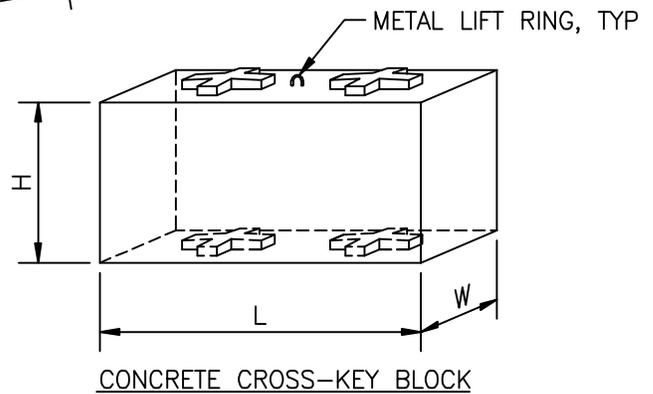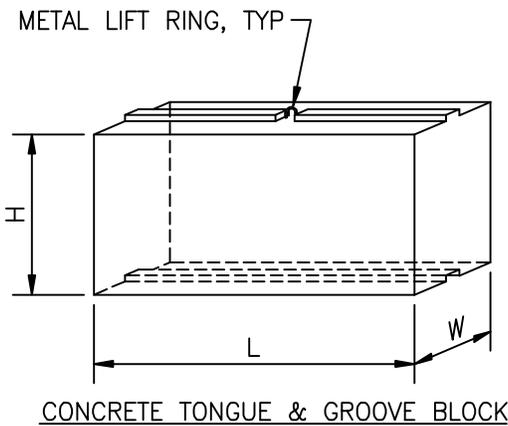

**NOTES:**

- GRAVITY BLOCK WALLS WITH GEOGRID REINFORCING MUST BE DESIGNED & STAMPED BY A STATE LICENSED PROFESSIONAL ENGINEER.
- GRAVITY BLOCK WALLS OVER 4'-0" IN HEIGHT AND/OR LOCATED IN A CRITICAL AREA OR MEADOWDALE EARTH SUBSIDENCE LANDSLIDE HAZARD AREA, REQUIRE A BUILDING PERMIT & MUST BE DESIGNED & STAMPED BY A STATE LICENSED PROFESSIONAL ENGINEER.



CITY OF EDMONDS

REVISIONS	
APPROVED BY	DATE

STANDARD DETAIL

**GRAVITY BLOCK WALL**

DATE	4/1/03	SCALE	NTS	DWG NO.	<b>E 8.11</b>
------	--------	-------	-----	---------	---------------