


(FOR FUTURE DEVELOPMENT)  
 SEWER STUB SHALL BE LOCATED 10' INSIDE PROPERTY LINE & STAKED. PLACE 2x4 AT END OF SIDE SEWER STUB AND CUT TO LENGTH TO ENSURE 3 FEET EXTENDS ABOVE GRADE. PAINT TOP 18 INCHES WHITE. IN 3 INCH HIGH LETTERS, STENCIL THE NUMBER OF EVEN FEET FROM GROUND ELEVATION TO THE SEWER STUB INVERT. 8 GAUGE WIRE TO BE DOUBLE WRAPPED AROUND PIPE AND 2x4 STAKE AT OR ABOVE FINISHED GRADE.

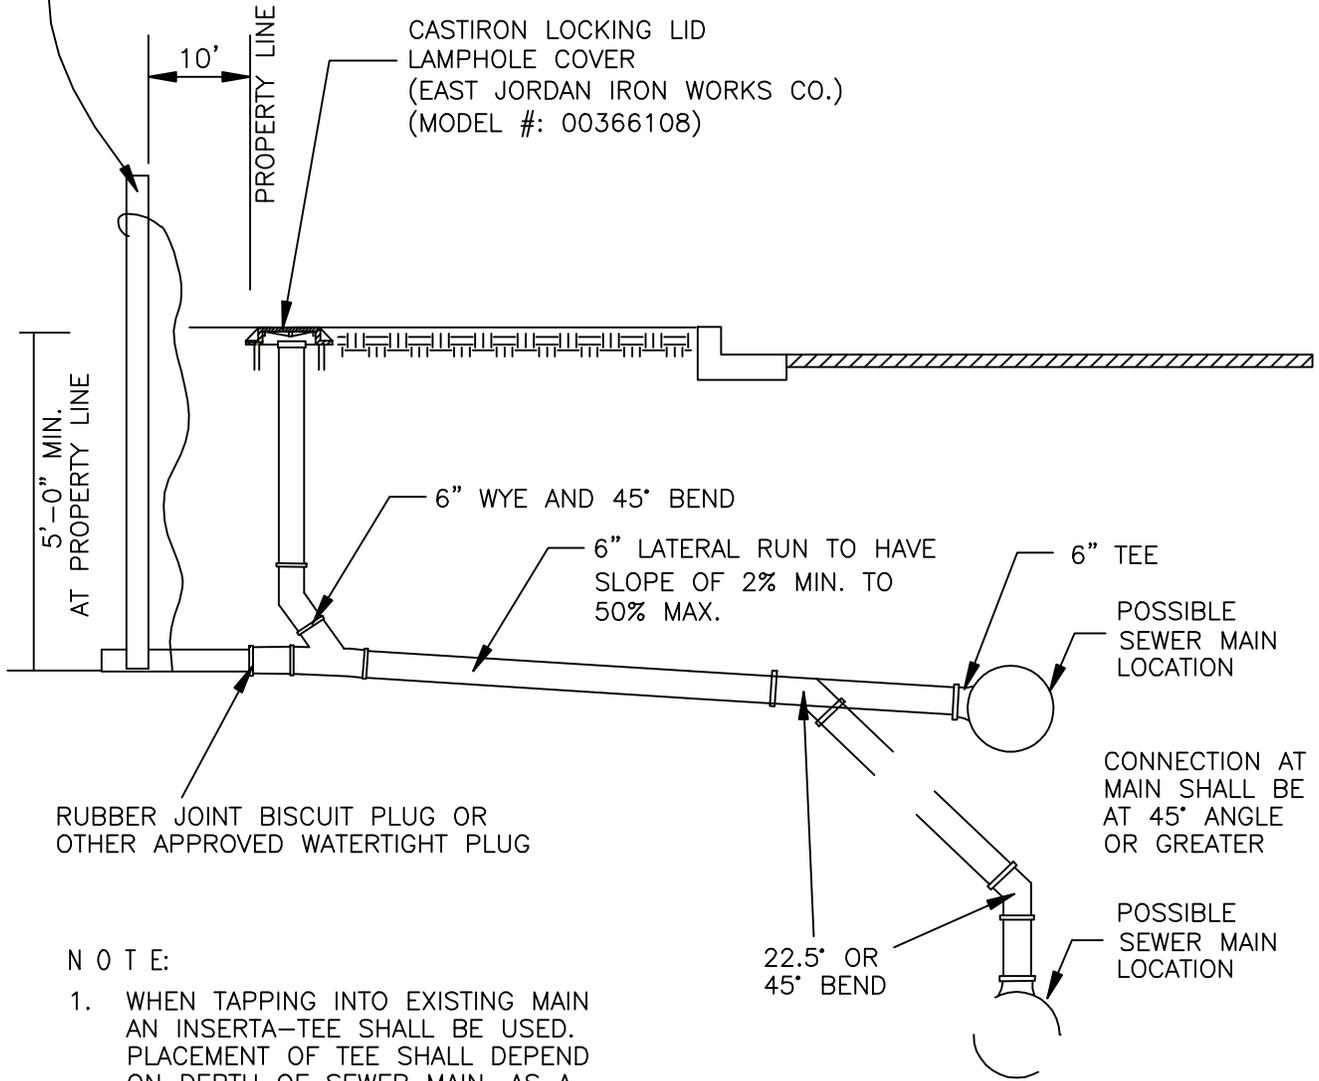

RUBBER JOINT BISCUIT PLUG OR OTHER APPROVED WATERTIGHT PLUG

**NOTE:**

1. WHEN TAPPING INTO EXISTING MAIN AN INSERTA-TEE SHALL BE USED. PLACEMENT OF TEE SHALL DEPEND ON DEPTH OF SEWER MAIN. AS A MINIMUM, THE TEE SHALL BE PLACED AT A 45 DEGREE ANGLE.
2. IF CONNECTING SIDE SEWER TO EXIST CONCRETE LATERAL, A CONCRETE/PVC ADAPTER SHALL BE USED AND SECURED PER MFGR'S INSTRUCTIONS.



CITY OF EDMONDS

REVISIONS		STANDARD DETAIL		
APPROVED BY	DATE			
D. GEBERT	01/28/04	<b>TYPICAL SEWER LATERAL</b>		
D. GEBERT	05/06/05			
D. GEBERT	4/2/07			
		DATE	SCALE	DWG NO.
		7/24/01	NTS	<b>E6.4</b>