


ASSEMBLIES SHOULD NOT BE PLACED IN AREAS SUBJECT TO VEHICULAR TRAFFIC. IF LOCATED IN TRAFFIC AREAS, THE LID SHALL BE TRAFFIC RATED AND SHALL BE INSTALLED FLUSH IN ASPHALT OR CONCRETE.



CITY INSPECTION REQUIRED BEFORE BACKFILL

REFER TO CITY HANDOUT #75 FOR DESIGN AND PERMIT REQUIREMENTS

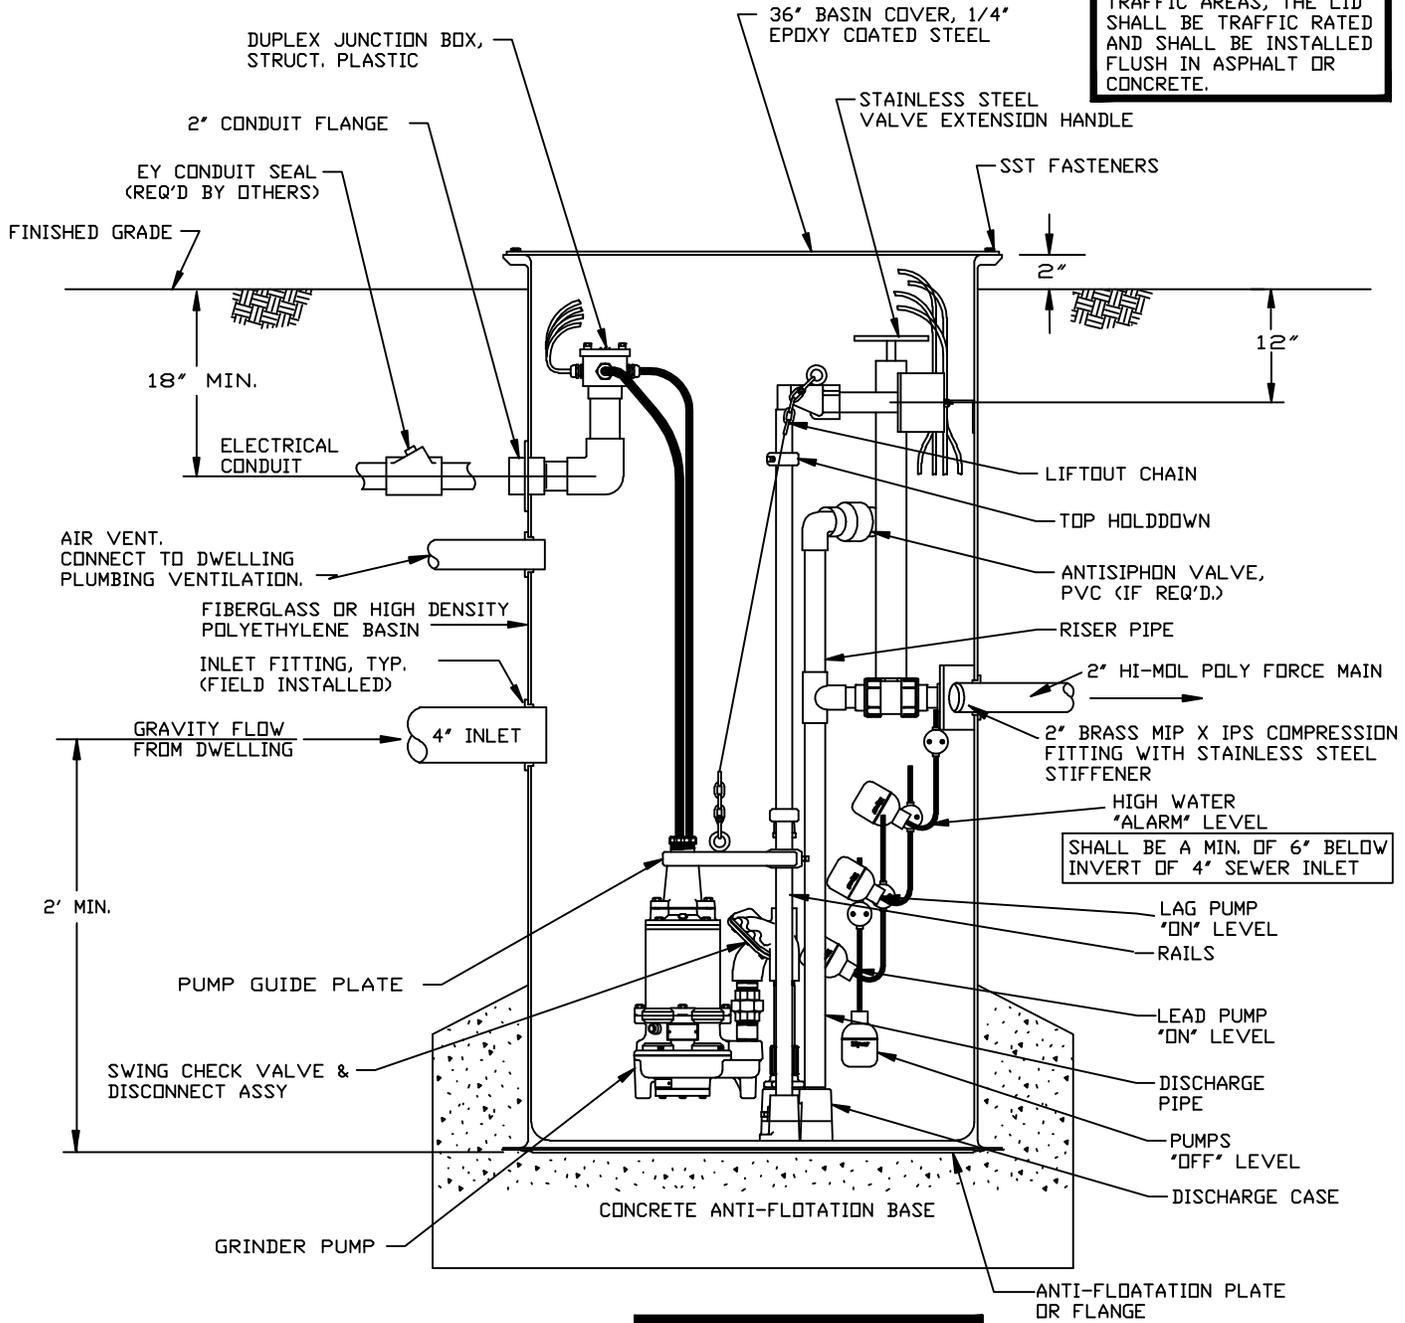

CITY OF EDMONDS

REVISIONS	
APPROVED BY	DATE
D. GEBERT	6/16/03
D. GEBERT	6/23/03
D. GEBERT	10/6/03

STANDARD DETAIL			
36" DUPLEX GRINDER PUMP WITH REMOTE MOUNTED CONTROL PANEL			
DATE	5/9/02	SCALE	NTS
DWG NO.		E6.8	